

# MODBUS-GW™

## Modbus Gateway



### Integration & Graphics

## General


The Modbus Gateway provides a communication link between networks that use the Modbus/TCP communication protocol and Fire Alarm Control Panels (FACPs) resident on an NFN network.

The NFN network communicates with the Modbus Gateway through a NOTI-FIRE-NET network via the network port on any NCM. The Modbus communication protocol is consistent with Modbus Application Protocol Specification V1.1b.

The Modbus Gateway Configuration Tool, a programming utility included with the Modbus Gateway assembly, is used to configure the Modbus Gateway. The Modbus Gateway is designed to need very little configuration. In most applications you will only need to enter the TCP/IP settings for your network and the nodes you would like to monitor. The gateway will automatically map all the configured points and supply you with a user friendly comma separated value report that defines the mapping.

## Features

- Compatible with standard and high speed NOTI-FIRE-NET
- Monitor four (4) compatible NFN or HS-NFN nodes not including the Modbus Gateway node itself.
- Allows remote control of FACP
- Provide data such as event type, active/inactive, enabled/disabled, acknowledged/unacknowledged, device type and system troubles.

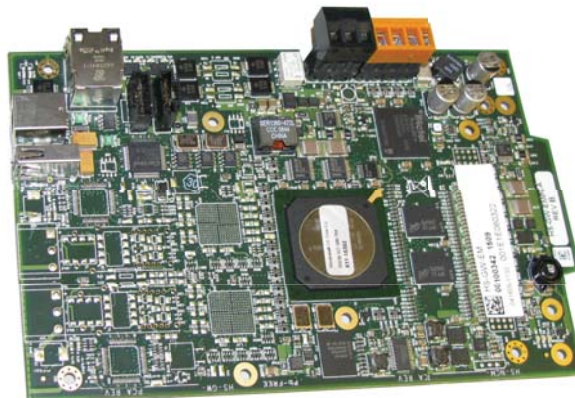

- Support reads of up to 100 registers at a time. Analog values can be read 10 registers at a time.
- Receive configuration data from the Modbus Gateway Configuration Tool.
- Log diagnostic information.
- Send standard Modbus exception responses.
- Reduce configuration time by self configuring all nodes and points.

## MODBUS MASTERS COMPATIBLE

- The Modbus Gateway was designed to be compatible with standard Modbus/TCP masters.
- Support one-byte Unit IDs.
- Have configurable polling times.
- The Modbus Gateway supports one Modbus Master.

## PANEL COMPATIBLE

The Modbus Gateway was designed to be compatible with the following panels:

- AFP-2800
- NFS2-3030

## System Architecture & Requirements

An Internet or Intranet IP network connection is required to configure the Modbus Gateway, and to connect it with Modbus clients. The Internet or Intranet IP network connection must meet the following requirements.

- Private or Business LAN
- Static IP address required
- Standard 100Base - T connection
- Required Ports(s): 502

### REQUIRED EQUIPMENT


- MODBUS-GW- NFN to Modbus Embedded Gateway.
- Network Control Module
- NFN Network - Version 5.0 or above
- Modbus Configuration Tool

## NETWORK COMPONENTS

- RJ45 to RJ45 standard Ethernet network cable customer's internet or intranet connection to Modbus Gateway
- NFN network version 5.0 or above (sold separately)
- High Speed Network Communication Module: HS-NCM-W/SF/MF board used to facilitate network communication between the Modbus Gateway and a High Speed NFN network or Network Communication Module: NCM-W/F board used to facilitate network communication between the Modbus Gateway and an NFN network.

### CUSTOMER SUPPLIED EQUIPMENT

- Windows XP based computer to run the Modbus Configuration Tool.

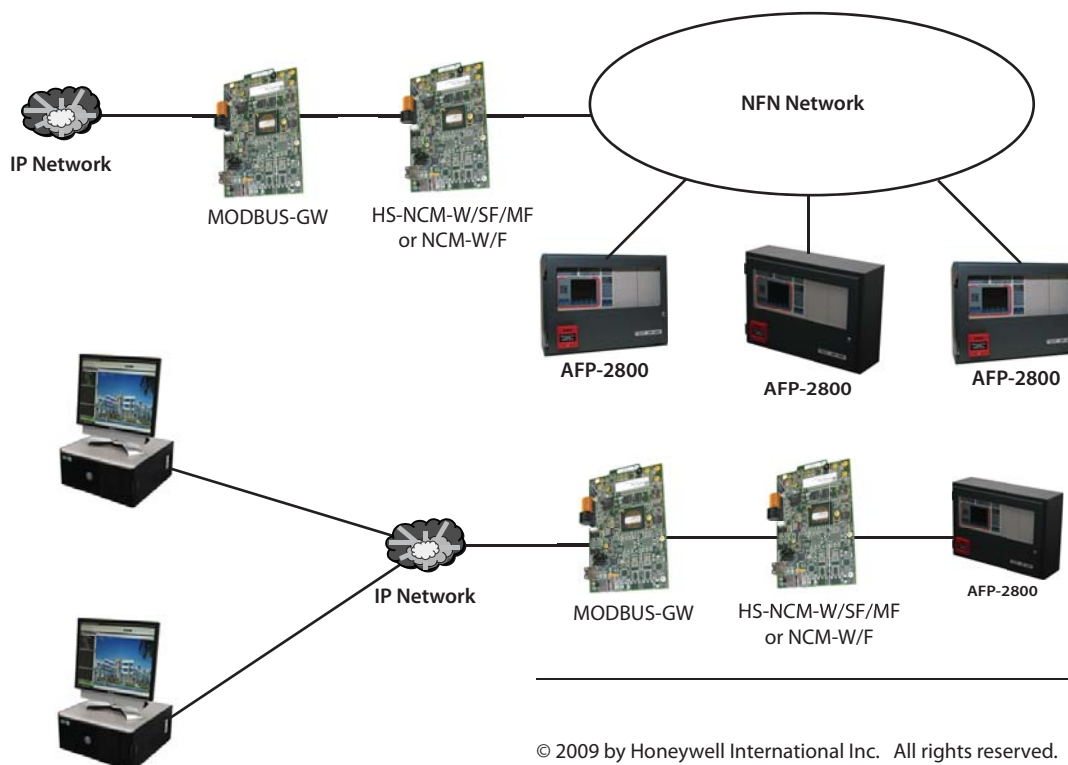

© 2009 by Honeywell International Inc. All rights reserved.  
Unauthorised use of this document is strictly prohibited.

This document is not intended for installation purposes.  
We try to keep our product information up-to-date and accurate.  
We cannot cover all specific applications or anticipate all requirements.  
All specifications are subject to change without notice.

For more information contact your nearest Notifier Sales Office or Distributor  
[www.notifier.com.au](http://www.notifier.com.au)